


FIRE RETARDANT TREATED
PLYWOOD, 0.75"x4'x8',
MASK RATED LABELS AND
PAINT WHITE (TYP)

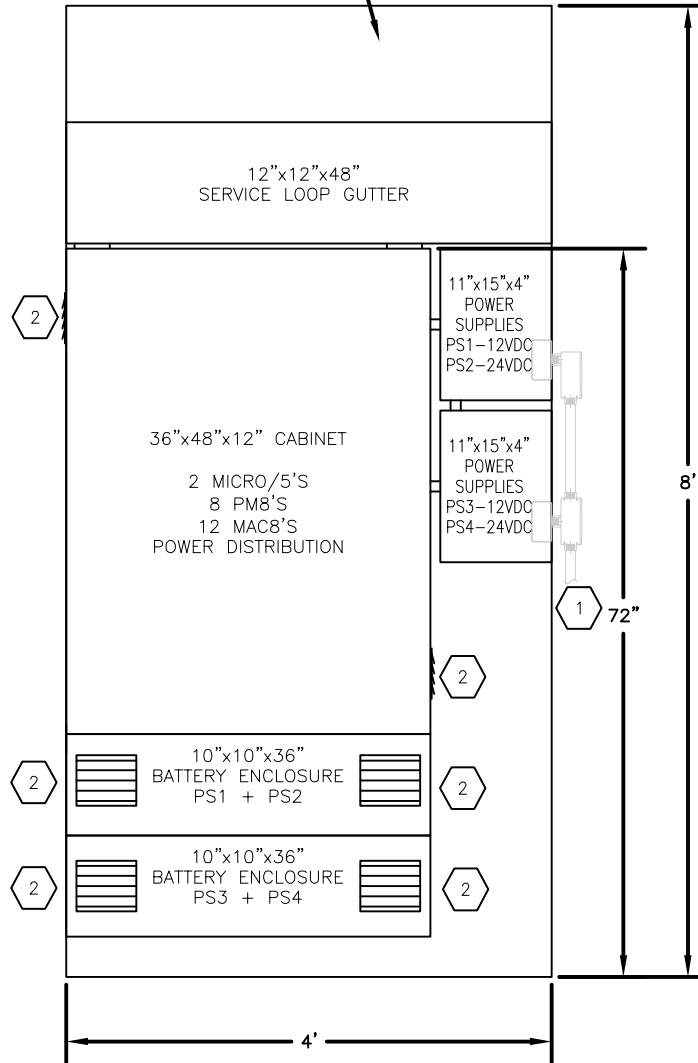

LAYOUT NOTES

- 1 120/230VAC 20-AMP, E-POWER CIRCUIT, CONDUIT, AND WIRING FOR SECURITY EQUIPMENT BY ELECTRICIAN.
- 2 MOUNT VENT KITS ON FRONT OF BATTERY ENCLOSURES AND ON BOTH SIDES OF CONTROLLER PANEL CABINET.
3. PROVIDE 3'-11" CLEAR SPACE IN FRONT OF PLYWOOD.

2

UTC SECURITY, PICTURE PERFECT, TWO MICRO/5'S
32 READER, FOUR 8RP BOARDS
WALL ELEVATION
ELEVATION

SCALE: 1"=1'-0"

LBNL ELECTRICAL STANDARDS
SECURITY CARD ACCESS SE5.70
UTC SECURITY, PICTURE PERFECT, TWO MICRO/5'S 32 READER

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DIVISION

DRAWN BY	DATE
CHECKED BY	
APPROVED BY	
CAD FILE PATH	
SCALE	NTS
DRAWING NO.	SHEET
SEC119A	2
PROJECT NO.	